


Note 1: Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft from any external source of ignition (e.g., open flame, window A/C, compressor), intake to direct-vented gas appliance, or intake to a mechanical ventilation system.

Note 2: This distance may be reduced to no less than 10 ft for a single container.

*Above ground ASME containers. (This figure for illustrative purposes only; code shall govern.)*

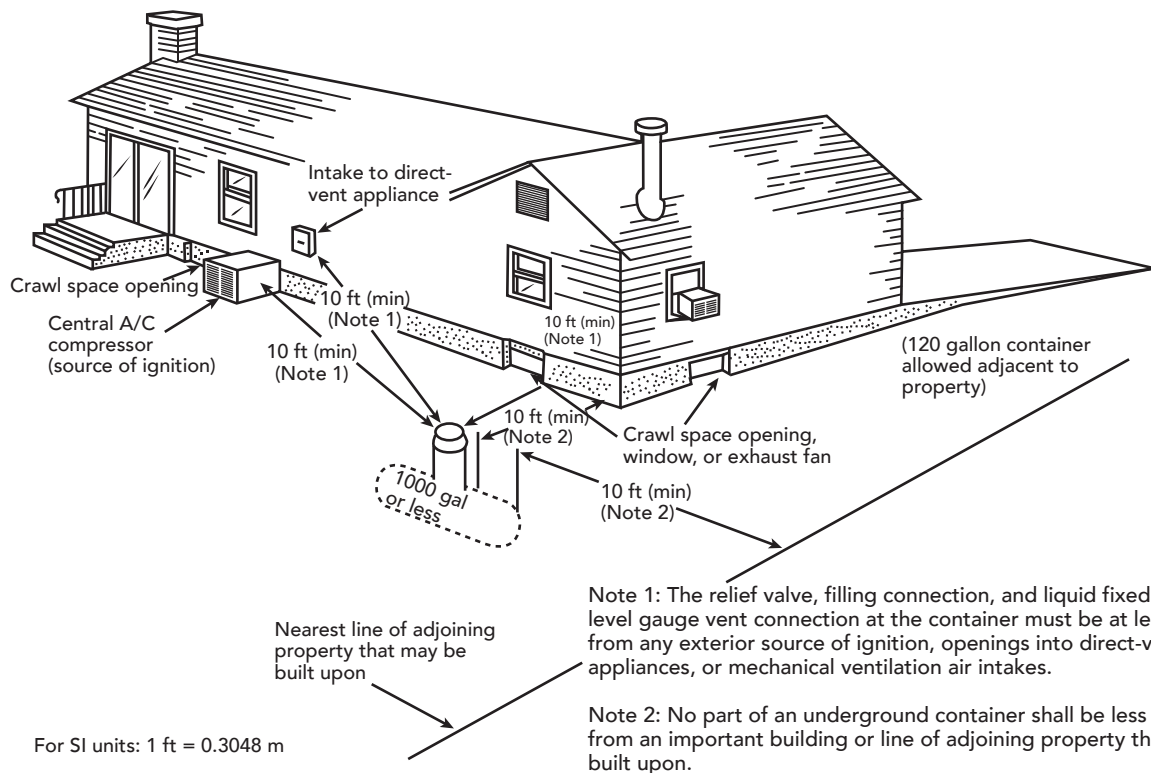

Note 1: The relief valve, filling connection, and liquid fixed maximum level gauge vent connection at the container must be at least 10 ft from any exterior source of ignition, openings into direct-vent appliances, or mechanical ventilation air intakes.

Note 2: No part of an underground container shall be less than 10 ft from an important building or line of adjoining property that may be built upon.

*Underground ASME containers. (This figure for illustrative purposes only; code shall govern.)*